



# DNH

HEAD OFFICE, NORWAY

**DNH AS**

Phone..... + 47 35 98 56 00

Fax..... + 47 35 98 56 10

E-mail..... dnh@dnh.no

Web-Site..... www.dnh.no

ENGLAND

**DNH WW Ltd**

Phone..... + 44 1908 275 000

Fax..... + 44 1908 275 100

E-mail..... dnh@dnh.co.uk

GERMANY

**DNH GmbH**

Phone... + 49 040 6569 30-0

Fax..... + 49 040 6569 30-30

E-mail..... dnh@dnh.de

USA

**DNH Speakers Inc**


Phone..... + 1 484 494 5790

Fax..... + 1 484 494 5793


E-mail..... dnh@dnhspeakers.com

ISO 9001 CERTIFIED

## JBP-120

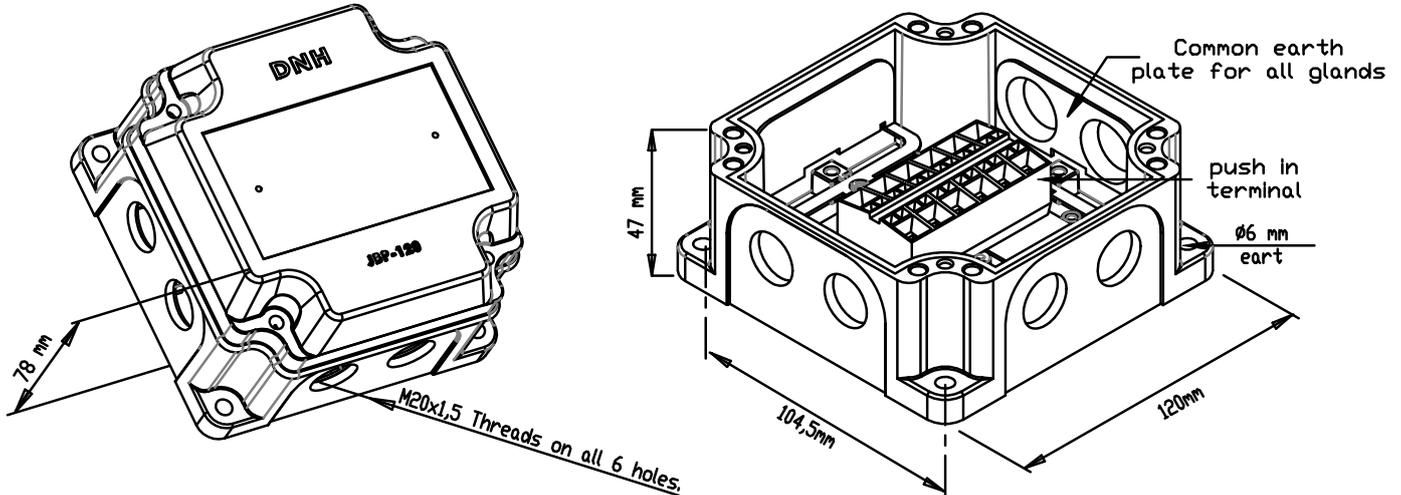

3 x M20 cable glands and  
4 x M20 blind plugs

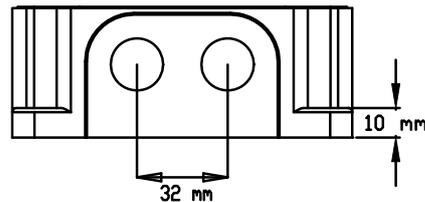

Specifications	
Material / Color	ASA / RAL 7035
Mounting	4 screws
Termination	Wago 264 terminal / earth plate / 2,5 mm <sup>2</sup> / 600V
Weight	0,35 kg
IP-rating	67
Max. / min. amb. temp	90°C / -50°C

### Installation, Operation and Maintenance Procedures

- Screw the box to the wall or ceiling with 2 - 4 screws.
- JBP-120 has six entries and is delivered with three M-20 Cable glands and 4 M-20 blind plugs.
- Every time the lid is removed for inspection, check that the gasket is fitted correctly to the lid before you refit the back lid. Do not use any lubricants on the gasket.
- Fasten lid with four screws, approximately 1 Nm, use washers on screws.
- JBP-120 is delivered with Wago terminal 264 with max 2,5 mm<sup>2</sup>.
- Junction box has two years warranty against defective workmanship.

DNH reserves the right to alter specifications without notice

