

# DNH

## Loudspeakers


---



### CAPEEX-6Tx2

Ex-cabinet loudspeaker (A+B)



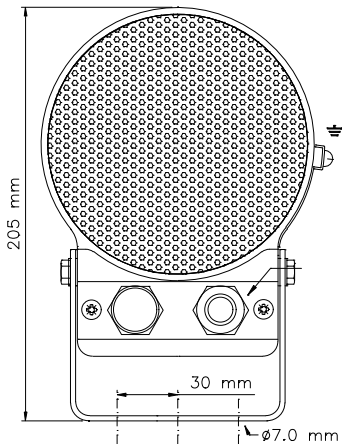

All outside nuts  
and screws in  
stainless steel

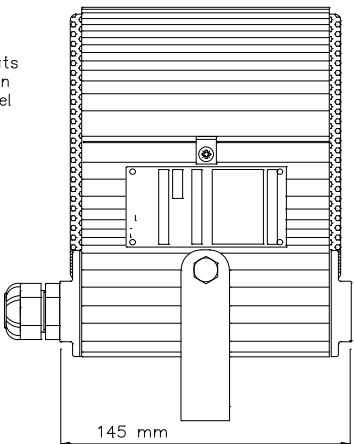


Fig. 1 - Technical drawing

100V TRANSFORMER tappings (standard)	
RED : YELLOW	3,0W
RED : GREEN	1,5W
RED : BLUE	0,75W




Fig. 2 - Circuit Diagram

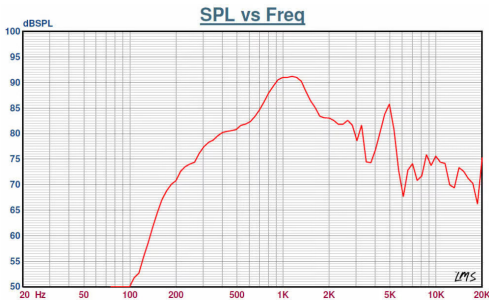


Fig. 3 - SPL at 1W/1m


## TECHNICAL SPECIFICATIONS

Material	Aluminium
Color	Anodized
Mounting	U-bracket
Cable entry (standard)	4xM20 blanking plugs
Termination (standard)	2xScrew terminal (e-chamber)
Weight	3,8 kg
IP-rating	54
Ambient Temp. Min/Max	-20°C / 40°C
Rated (standard) / max. power	3W / 2x3W
SPL 1W/1m	81 dB
SPL rated power	85 dB
Freq. range	150 - 20000 Hz
Effective freq. range	190 - 20000 Hz
Dispersion (-6dB) 1kHz / 4kHz	NA
Directivity factor, Q1kHz	NA
Options	Impedance, transformer, cable glands.



Copy of all certificates can be found  
by scanning QR-code or going to the  
DNH web page: [www.dnh.no](http://www.dnh.no)

## APPROVALS AND CERTIFICATIONS

Ex-marking	 II 2 G Ex d e IIB+H <sub>2</sub> T6 Gb
IECEX	IECEX NEM 11.0016
ATEX	Nemko 10 ATEX 1054
Other certificates (variants*)	INMETRO, US/CAN, ECAS Ex
*contact the Sales team to ensure you get the right approvals	

## INSTALLATION, OPERATION AND MAINTENANCE PROCEDURES:

**WARNING: Do not open the Ex-loudspeaker when the speaker is energized.**

1. Enter the e-chamber by loosening the screws on the lid.
2. Use only appropriate ATEX certified 'Ex eb' cable glands/blind plugs reflecting the same specifications as the rest of the loudspeaker with respect to IP rating and environmental temperature.
3. Lead cable through cable gland and connect to the terminal according to required tapping.
4. For screw terminals, all terminal screws, used and unused, shall be tightened down to between:  
BK – TUV 18 ATEX 8209U: 0,5Nm and 0,7Nm  
MK – TUV 18 ATEX 8209U: 0,4Nm and 0,45Nm
5. If the Ex-loudspeaker is to be earthed use marked earth screw inside the termination chamber and/or on the outside of the loudspeaker housing.
6. Fasten lid screws with a torque of 2 – 2,2 Nm to ensure the IP rating.
7. To change the position of the loudspeaker, please adjust bracket (by loosening / tightening the bolts) as required.
8. To ensure IP X4 rating the loudspeaker must be installed with the surface of the sound openings in a vertical position.
9. Be sure that the Ex-loudspeakers (A+B) are connected to the same phase and correct voltage, frequency and power stated on labels on the model.
10. Be sure that the environmental temperature is within the certified temperature range.
11. Keep the loudspeaker clean of foreign elements, such as chemicals, soaps, acids etc.
12. Optional MF model (maintenance free) has moulded e-chamber and fitted with permanent cable. Constructed not to be opened.
13. Model variants are indicated on separate label. CAPEEX-6/T/x2/MF.
14. CAPEEX-6(T) is certified according to Directive 2014/34/EU and EN 60079-0:2012+A11:2013, EN 60079-1:2007, EN 60079-7:2007.
15. The loudspeaker is supplied with two years warranty against defective workmanship.





*Makes the world sound*

Design, manufacture and quality by

**DNH A/S Den Norske Høytalerfabrikk A/S**

Gruveveien 2-4

3770 Kragerø

Norway

Tel: +47 35 98 56 00

Mail: [dnh@dnh.no](mailto:dnh@dnh.no)

[www.dnh.no](http://www.dnh.no)

## SUBSIDIARIES

---

**DNH GmbH**

Neumann-Reichardt-Str. 27-33

22041 Hamburg

Germany

Tel: +49 (0) 40 - 65 69 30-0

Mail: [dnh@dnh.de](mailto:dnh@dnh.de)

[www.dnh.de](http://www.dnh.de)

**DNH WW Ltd.**

31 Clarke Rd.

Mount Farm, Bletchley

Milton Keynes, MK1 1LG

England

Tel: +44 1908 275 000

Mail: [dnh@dnh.co.uk](mailto:dnh@dnh.co.uk)

[www.dnh.no](http://www.dnh.no)

**DNH Speakers Inc.**

900 Calcon Hook Road, Bay 16

Sharon Hill

19079 PA

USA

Tel: +1 484-494-5790

Mail: [dnh@dnhspeakers.com](mailto:dnh@dnhspeakers.com)

[www.dnh.no](http://www.dnh.no)